

# TECHNICAL REPORT



Expertise • Independence • Integrity

FIRA International Limited  
Maxwell Road, Stevenage  
Hertfordshire SG1 2EW  
T +44 (0)1438 777 700  
F +44 (0)1438 777 800  
E [info@fira.co.uk](mailto:info@fira.co.uk)

A member of the BM TRADA Group of companies  
Registered Office: Chiltern House, Stocking Lane  
Hughenden Valley, High Wycombe  
Buckinghamshire HP14 4ND UK  
Registered No. 3181481 England

## RICHARD BURBIDGE LIMITED

Whittington Road  
Oswestry  
Shropshire  
SY11 1HZ

Our Ref:

**TRELF31618**

Date:

23<sup>rd</sup> December 2009

Delivery Date:

21<sup>st</sup> December 2009

Test Dates:

22<sup>nd</sup> December 2009

For the attention of Tony Jones

## SAMPLE(S) FOR TEST:

One Decking Balustrade, Ref: OB12 Metal Baluster Unit

## TEST REQUIREMENTS:

BS 6180: 1999: Barriers in and about buildings – Code of practice  
- Domestic Use– Clause 6.4.1

## RESULT :

PASS

FIRA is a UKAS TESTING Laboratory No. 0174

Tests marked "Not UKAS Accredited" in this Report are not included in the UKAS Accreditation Schedule for our laboratory.

Opinions and interpretations expressed herein are outside the scope of UKAS Accreditation.

This Report relates to the sample(s) submitted for test and no others. Additions, deletions or alterations are not permitted.

Test reports are given to the client in confidence, and may only be reproduced in whole or in part with written permission from FIRA. Note that the words "tested by FIRA" may be used in subsequent publicity for the product; "approved" must **not** be used.

Tests are carried out on the understanding that neither the Association nor its officers can accept any legal responsibility for information or advice given or opinions expressed whether in response to specific enquiries or otherwise.

This Report is given subject to the Terms of Business of FIRA International which are available from the Secretary at the address shown.



0174

TRELF31618  
Page 1 of 11

# TECHNICAL REPORT

## INTRODUCTION

As part of the BM TRADA Certification Ltd Balustrade Product Conformity Scheme, FIRA was commissioned to undertake structural testing of Richard Burbidge OB12 Metal Baluster Unit in accordance with the requirements of the following documents:

BS 6180: 1999: Barriers in and about buildings – Code of practice

BS 6399: Part 1: 1996: Loading for buildings - Code of practice for dead and imposed loads

BS 5268: Part 2: 2002: Structural use of timber – Code of practice for permissible stress design, materials and workmanship

The intention of the testing was to assess whether the products were structurally suitable for use in Domestic arenas. Their failure mode and critical failure load were to be established in order to assess and improve upon future designs with the outcome that the developed design could be included in the BM TRADA Certification Ltd Balustrade Product Conformity Scheme.



0174

TRELF31618  
Page 2 of 11



# TECHNICAL REPORT

## TEST SPECIMEN(S)

**DESCRIPTION OF SPECIMEN:** Domestic metal baluster, stop chamfer decking system with 19 x Metal balusters fixed to the timber "L" rail, using stainless steel screws. **HORIZONTAL** unit set to a minimum height of 900mm and 2.4m handrail length to centre of newels. Tested to 0.36kN/m.

<b>MATERIAL TYPE</b>	Pine ( <i>Pinus sylvestris</i> )
<b>SYSTEM</b>	Domestic stop chamfer decking, horizontal with metal baluster in-fill
<b>DESCRIPTION OF TEST UNIT</b>	<i>See Attached Diagram</i>
<b>HANDRAIL – LENGTH</b>	2400m <i>See Attached Diagram</i>
<b>TOP AND BOTTOM "L" – LD259</b> 06-0000-002-0709	Pine "L" Rail - 2400 x 58 x 68
<b>METAL BALUSTER – LD261</b> 06-0215-001-0509	Aluminium Abbey black metal baluster,  820mm x 26mm x 6mm
<b>NEWEL DIMENSIONS</b> 06-0000-997-0809  LD257	1375mm x 82mm x 82mm  Stop chamfer Newel
<b>STRING/JOIST DIMENSIONS</b>	150mm x 28mm x 2482 mm
<b>CONNECTORS/BRACKETS USED</b>  Decking fixing strap – LD330 06-0000-707-A0208	Stainless Steel (A4) – To fix the rail to the newels
<b>FLAT CAPPING RAIL – LD220</b> 06-0000-689-0101	Pine rail 2400 x 115 x 27mm
<b>FIXINGS USED</b>	4.2mm x 19mm, flat head, csk (A4) Stainless steel screw. 4.2mm x 25mm, flat head, csk (A4) Stainless steel screw. <b>4.2mm x 65mm, flat head, CSK (A2) Stainless steel screws.</b>

Product descriptions produced by FIRA International Ltd give basic Construction, Material and Dimensional information and are not intended to represent a complete product specification. Overall product dimensions will be recorded accurately. Where variations in material thickness occur, dimensions will be taken as standard thickness.



0174

TRELF31618  
Page 3 of 11



# TECHNICAL REPORT

## TEST PROCEDURE

The decking balustrade is laid horizontally and mounted in a universal test rig with both end newels fully supported by and clamped to Aluminium channel sections.

### **Balustrade Handrail Stiffness Test**

A uniformly distributed load is applied to the handrail using hydraulic rams and a calibrated compression load cell.

It has been found that in general the aforementioned test method causes timber based balustrades to deflect by amounts greater than the 25mm required by the standard. However in such cases the increased deflection does not necessarily present a safety hazard to the user, as the balustrade remains intact. In such cases the BM TRADA Certification Ltd Balustrade Product Conformity Scheme states that, where the aforementioned deflection limit is exceeded, the unit will be deemed to have satisfied the requirements of the scheme provided that it is capable of passing the strength of handrail test.

### **Handrail Strength Test**

A uniformly distributed load is applied to the handrail using hydraulic rams and a calibrated compression load cell. The load is maintained for a period of 15 minutes, at the end of which the balustrade is inspected for structural damage.

### **In- fill strength**

A uniformly distributed load is applied to the handrail using calibrated weights and load bags laid on top of a foam sheet, which rests on the in-fill. The load is maintained for a period of 15 minutes, at the end of which the balustrade is inspected for structural damage. Experience has shown that if the in- fill can sustain the load when it is initially applied, then unless there is visual movement or lots of cracking noises at the fixings it not necessary to hold the load for 15 minutes.

### **Baluster Strength**

The point load is applied through the application of calibrated weights and load bags hung from a hook in the middle of the baluster. Five balusters are subjected to the testing to establish consistency. Experience has shown that if the in- fill can sustain the load when it is initially applied, then unless there is visual movement or lots of cracking noises at the fixings it not necessary to hold the load for 15 minutes, at the end of which the balustrade is inspected for structural damage



# TECHNICAL REPORT

## TEST RESULTS

### BS 6180: 1999, Clause 6.4.1 Balustrade horizontal deflection test

Item: OB12 Metal Baluster Unit

Test Level: Domestic Applications

Initial Inspection: No apparent faults.

### Load Table

	<u>Domestic Level</u>	DL x Q-Mark Safety Factor
Load per Meter	0.36kN/m	0.9kN/m
UDL Required	864N	Not Required
UDL Achieved	216N per cylinder	Not Required
UDL to In-fill	0.5 kN/m <sup>2</sup>	
UDL <sup>2</sup> Required	99kg	
UDL <sup>2</sup> Achieved	99kg	
PL Balusters Required	0.25kN	
PL Balusters Achieved	25kg	

### Results Table

TEST	TEST REQUIREMENT		RESULT- Commercial Level
Handrail Stiffness	Design Load	Initial Loading	PASS
		Deflection	3mm
Handrail Strength	Q-Mark	Initial Loading	Not Required
		After 15 minutes	Not Required
In-fill Strength	Design Load	Initial Loading	PASS
Strength of Balusters	Design Load	Initial Loading	PASS

\* See COMMENTS



0174

TRELF31618  
Page 5 of 11



# TECHNICAL REPORT

## COMMENTS

As the deflection of the handrail was less than 25 mm during the test to communal domestic loading levels there was no need to assess the sample to the BS 5268: Part 2: 2002 Safety Factor for domestic applications or to the Q-Mark safety factor.

## CONCLUSION

When tested the OB12 Metal Baluster Unit supplied by Richard Burbidge Ltd satisfied the selected combined rules of BS 6180: 1999: Barriers in and about buildings and BS 5268: Part 2: 2002: Structural use of timber – Code of practice for permissible stress design, materials and workmanship.

The OB12 Metal Baluster Unit is therefore considered to be suitable for commercial applications when used in spans of 2400mm between the centres of newel posts.

### NOTE(S)

A(i), B & E (iii & iv) are the full range of applications for which the products are suitable as specified by BS 6399: Part 1: 1996. For more information see ANNEX B.

Tested by: B Mellor, J Moore and R Odhavji

Reported & Approved by: Rishi Odhavji  
Development Engineer - Testing Services



0174

TRELF31618  
Page 6 of 11



**TECHNICAL REPORT**



Plate 1: OB12 Metal Baluster Unit before Test



Plate 2: OB12 Metal Baluster Unit on Test



# TECHNICAL REPORT



Plate 3: OB12 Metal Balustrade Unit with In-fill load applied

**METAL BALUSTER SYSTEM**  
**2.4m HORIZONTAL TEST UNIT - REF OB012**

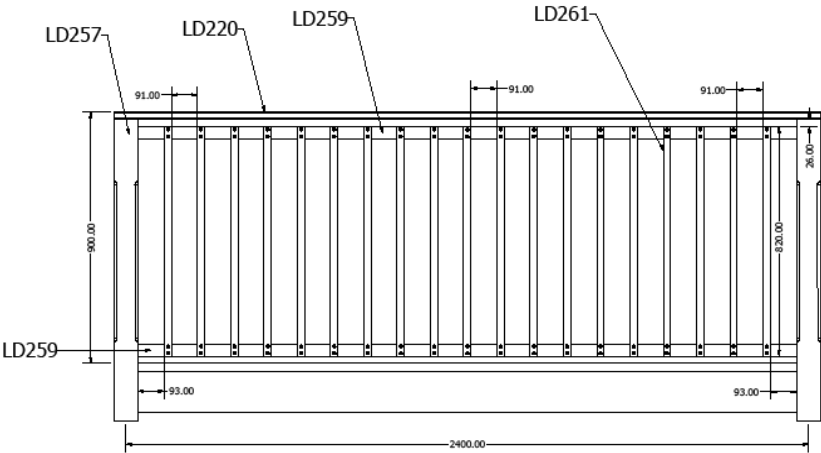


Plate 4: Drawing of OB12 Metal Balustrade Unit





# TECHNICAL REPORT

## ANNEX A

### Test Requirements

#### HAND RAIL TEST

##### Stiffness test

Initially a stiffness test is to be carried out by applying the test loads for 15 minutes checking that the net deflection of the handrail at mid length between supports is less than 25mm. In accordance with BS 6180, the test loads were taken from BS 6399-1, table 4. These are based on the building-use categories, which are defined in Table 6.2.

The net handrail deflection is defined as:

$$d_{h,net} = d_{h,total} - d_{newel} - d_{stringer}, \text{ where}$$

$d_{h,total}$  = Total deflection at mid span of handrail in the direction of the load

$d_{newel}$  = Deflection of the newel in the direction of the load. Deflection is to be measured at the crossing point between centreline of hand rail and centre line of newel.

$d_{stringer}$  = Deflection of mid span of the stringer in the direction of load. Deflection is to be measured at mid span of the stringer. This measurement is not applicable to balustrades with cut stringers (raised bottom rail).

For balustrades with glass components, the maximum deflection is  $L/65$  or 25 mm which ever is the smaller. The definition of L should be sought in sections 8.3, 8.4 or 8.5 in BS 61800, as it is dependent on the actual design.

If the balustrade fails the deflection test, without experiencing permanent damage, it is suggested that a strength test be carried out.

##### Strength test

BS 6180 "Code of practice for barriers in and about buildings" only refers to a maximum deflection limit under design load. However for timber balustrades this limit has proven difficult to comply with although timber balustrades have been used safely for many years.

TRADA has taken a practical view on this and suggests that the overall deflection is of less importance providing the balustrade passes a strength test in accordance with Section 8 of BS 5268-2.

In accordance with this method the balustrade is to be loaded with an ultimate load of design load multiplied with the product of  $K_{73}$  and  $K_{85}$  of BS 5268-2. The balustrade is to sustain this load for 15minutes without failing (breaking).

As per guidance in BS 6180, the design loads have been taken from Table 4 in BS 6399-1.

TRADA suggests that loads on stairs can be considered "medium term", which means that the overall load safety factor ( $K_{73} \times K_{85}$ ) will range from 1.79 (if five identical balustrades are tested) and 2.24 (if only one balustrade is tested).

The Q-mark scheme was set up when an earlier version of BS 5268-2 was governing. At that time the safety ranged between 2 (for five tests) and 2.5 (for one test). These are equivalent to the overall load safety factor ( $K_{73} \times K_{85}$ ) for "long term" loads on the current version of BS 5268-2. For consistency these factors are still used for the Q-mark tests.

It is suggested that initially the "medium term" loads (given as "5268" loads in table 6.1 is applied for 15 minutes. If the rail passes, additional load to fulfil the Q-mark regulations is applied and the whole load is held for another 15 minutes.

If the balustrade fails to withstand the 15 minutes with "Q-mark" loading, but passes the "5268" load the client will not be able to have the balustrade Q-mark certified, but can receive a test report claiming compliance with combined rules of BS 6180 and 5268-2.

#### SPINDLE / INFILL TESTS



0174

TRELF31618  
Page 9 of 11



# TECHNICAL REPORT

## Individual spindles

BS 6180 does not give a deflection limit for spindles, which means that a strength test is required unless calculations can prove that the spindles can withstand the design load given in BS 6399-1, Table 4. Clause 6.3.1 in BS 6180 allows the design load to be halved when the infill "consist of successive balusters".

As these tests are relatively "quick and easy" to do, it is suggested that a minimum of 5 balusters are tested, giving a safety factor of 1.79 for "5268" loads and 2.00 for Q-mark loads. The test loads to be applied are given in table 6.2 in Annex B. It should however be noted that the Q-mark scheme requires all spindles to be tested.



0174

TRELF31618  
Page 10 of 11



# TECHNICAL REPORT

## ANNEX B

**Table 6.2 Use of buildings or part buildings**

Taken from BS 6399: Part 1: 1996: Loading for buildings - Code of practice for dead and imposed loads.

Building-Use category	Type of occupancy for part of the building or structure	Descriptive title
A	Domestic and residential activities	(i) All areas within or serving exclusively one single family dwelling including stairs, landings, etc. but excluding external balconies and edges of roofs (see C3 ix)
		Other residential, (but also see C)
B and E	Offices and work areas not included elsewhere including storage areas	(iii) Light access stairs and gangways not more than 600 mm wide (not applicable to stair rails)
		(iv) Light pedestrian traffic routes in industrial and storage buildings except designated escape routes
		(v) Areas not susceptible to overcrowding in office and industrial buildings also industrial and storage buildings except as given above
C	Areas where people may congregate	
C1/C2	Areas with tables or fixed seating	(vi) Areas having fixed seating within 530 mm of the barrier, balustrade or parapet
		(vii) Restaurants and bars
C3	Areas without obstacles for moving people and not susceptible to overcrowding	(viii) Stairs, landings, corridors, ramps
		(ix) External balconies and edges of roofs. Footways and pavements within building curtilage adjacent to basement/sunken areas
C5	Areas susceptible to overcrowding	(x) Footways or pavements less than 3 m wide adjacent to sunken areas
		(xi) Theatres, cinemas, discotheques, bars, auditoria, shopping malls, assembly areas, studio. Footways or pavements greater than 3 m wide adjacent to sunken areas
		(xii) Grandstands and stadia
D	Retail areas	(xiii) All retail areas including public areas of banks/building societies or betting shops. For areas where overcrowding may occur, see C5
F/G	Vehicular	(xiv) Pedestrian areas in car parks including stairs, landings, ramps, edges or internal floors, footways, edges of roofs
		(xv) Horizontal loads imposed by vehicles



0174

TRELF31618  
Page 11 of 11

